
STORAGE TANK REQUIREMENTS


County Administrative Center 810 Court St Jackson, California 95642 Telephone: (209) 223-6422 Website: www.amadorgov.org

EMERGENCY WATER STORAGE STANDARDS AMADOR COUNTY ORDINANCE #15.30

FIRE REQUIREMENT -MINIMUM OF 2500 GAL. TANK, NOT INCLUDING DOMESTIC STORAGE



TANKS TO BE CONSTRUCTED OF MOLDED PLASTIC, FIBERGLASS, OR GALVANIZED STEEL, NOT LESS THAN 12 GAUGE.

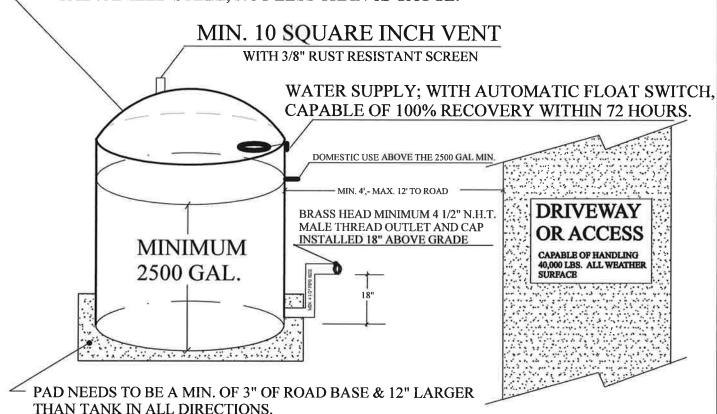

LOCATION: TANK NOT LESS THAN 50' FROM STRUCTURE. NOT LESS THAN 4' NOR MORE THAN 12' FROM ROADWAY, READILY ACCESSIBLE FOR FIRE APPARATUS. MINIMUM 8' FROM FLAMABLE VEGETATION. REFLECTIVE BLUE SPHERE MOUNTED WITH ADDRESS NUMBERS TO IDENTIFY TANK.

TANK LOCATION IS SUBJECT TO THE APPROVAL OF THE BUILDING DEPARTMENT.