


GATED ENTRANCE

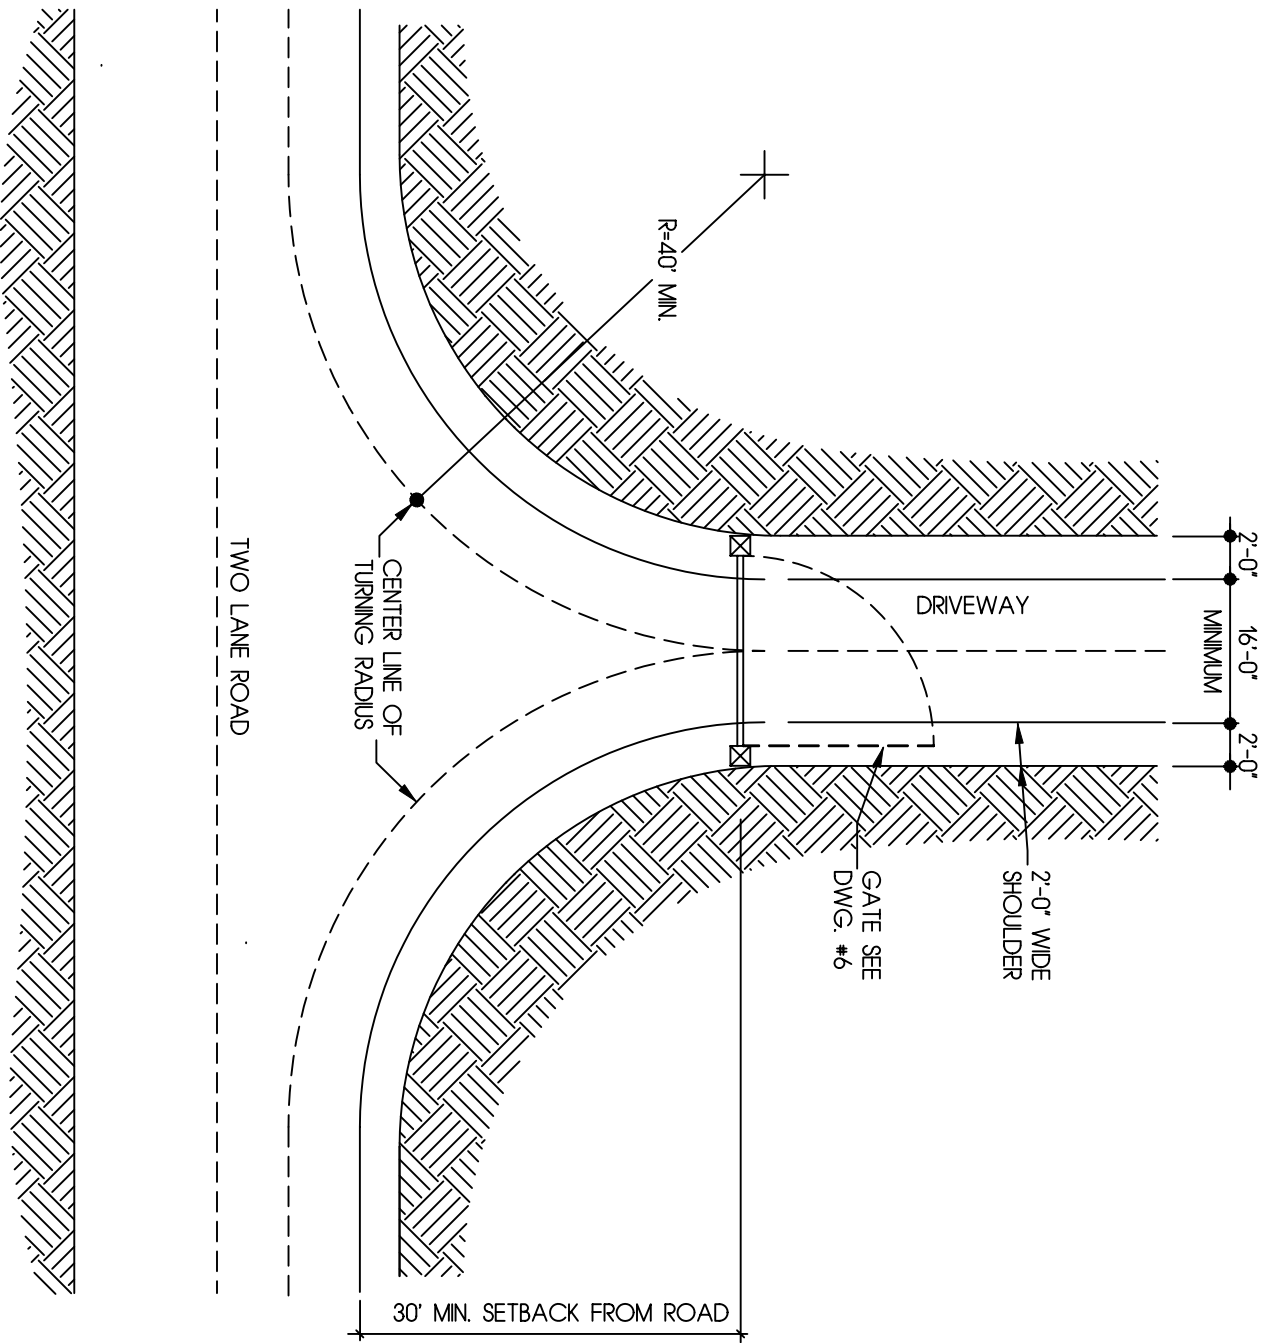

- GATE ENTRANCE SHALL BE 2 FEET WIDER THAN THE WIDTH OF THE TRAFFIC LANE.
- 30 FEET FROM THE ROADWAY AND SHALL ALLOW A VEHICLE TO STOP WITHOUT OBSTRUCTING TRAFFIC
- PROVIDE FIRE DEPARTMENT APPROVED KEY ACCESS
- CENTER LINE OF LANE TURNING RADIUS TO BE NOT LESS THAN 40 FEET

GATE ENTRANCE

FIRE SAFE STANDARDS

ST. HELENA FIRE DEPARTMENT

1480 MAIN STREET
ST. HELENA, CALIFORNIA 94574
TELEPHONE (707) 967-2792 FAX (707) 963-7748

1/16" = 1'-0"

SCALE

REVISION DATE
MAY 15, 2009

5

DRAWING NO. 1