




Notes:

1. New wells require an equivalent increase in recharge.
2. Water mains are not permitted to cross a pressure zone boundary unless equipped with a pressure regulating device.
3. Connections made to large transmission mains are only permitted at major intersections. Any intermediate connections proposed by a developer shall be evaluated on a case by case basis.
4. Developments located along a pressure zone boundary are not permitted to connect to an adjacent water main until approval for a proposed connection is issued by the City. This condition applies to all potential urban sites with a frontage along Logan Avenue, Dry Creek, and Thompson Avenue.
5. Large transmission mains (18" diameter and larger) surrounding Old Town and extending up to Reservoir 3 are not shown in their final alignments.
6. Future pipe diameters are based on the 1999 WMP.
7. The need for a future PSV @ Dry Creek/Shepherd is dependent on how the City decides to provide water service to the Northwest Village.
8. A parallel pipeline in Sunnyside Avenue from Teague to Shepherd is only required if the City decides to deliver water to rural residential users along this alignment.
9. Res. 2 is offline because the water system HGL is greater than the elevation of the overflow.
10. Res. 1 is abandoned.

**(January 2008)**

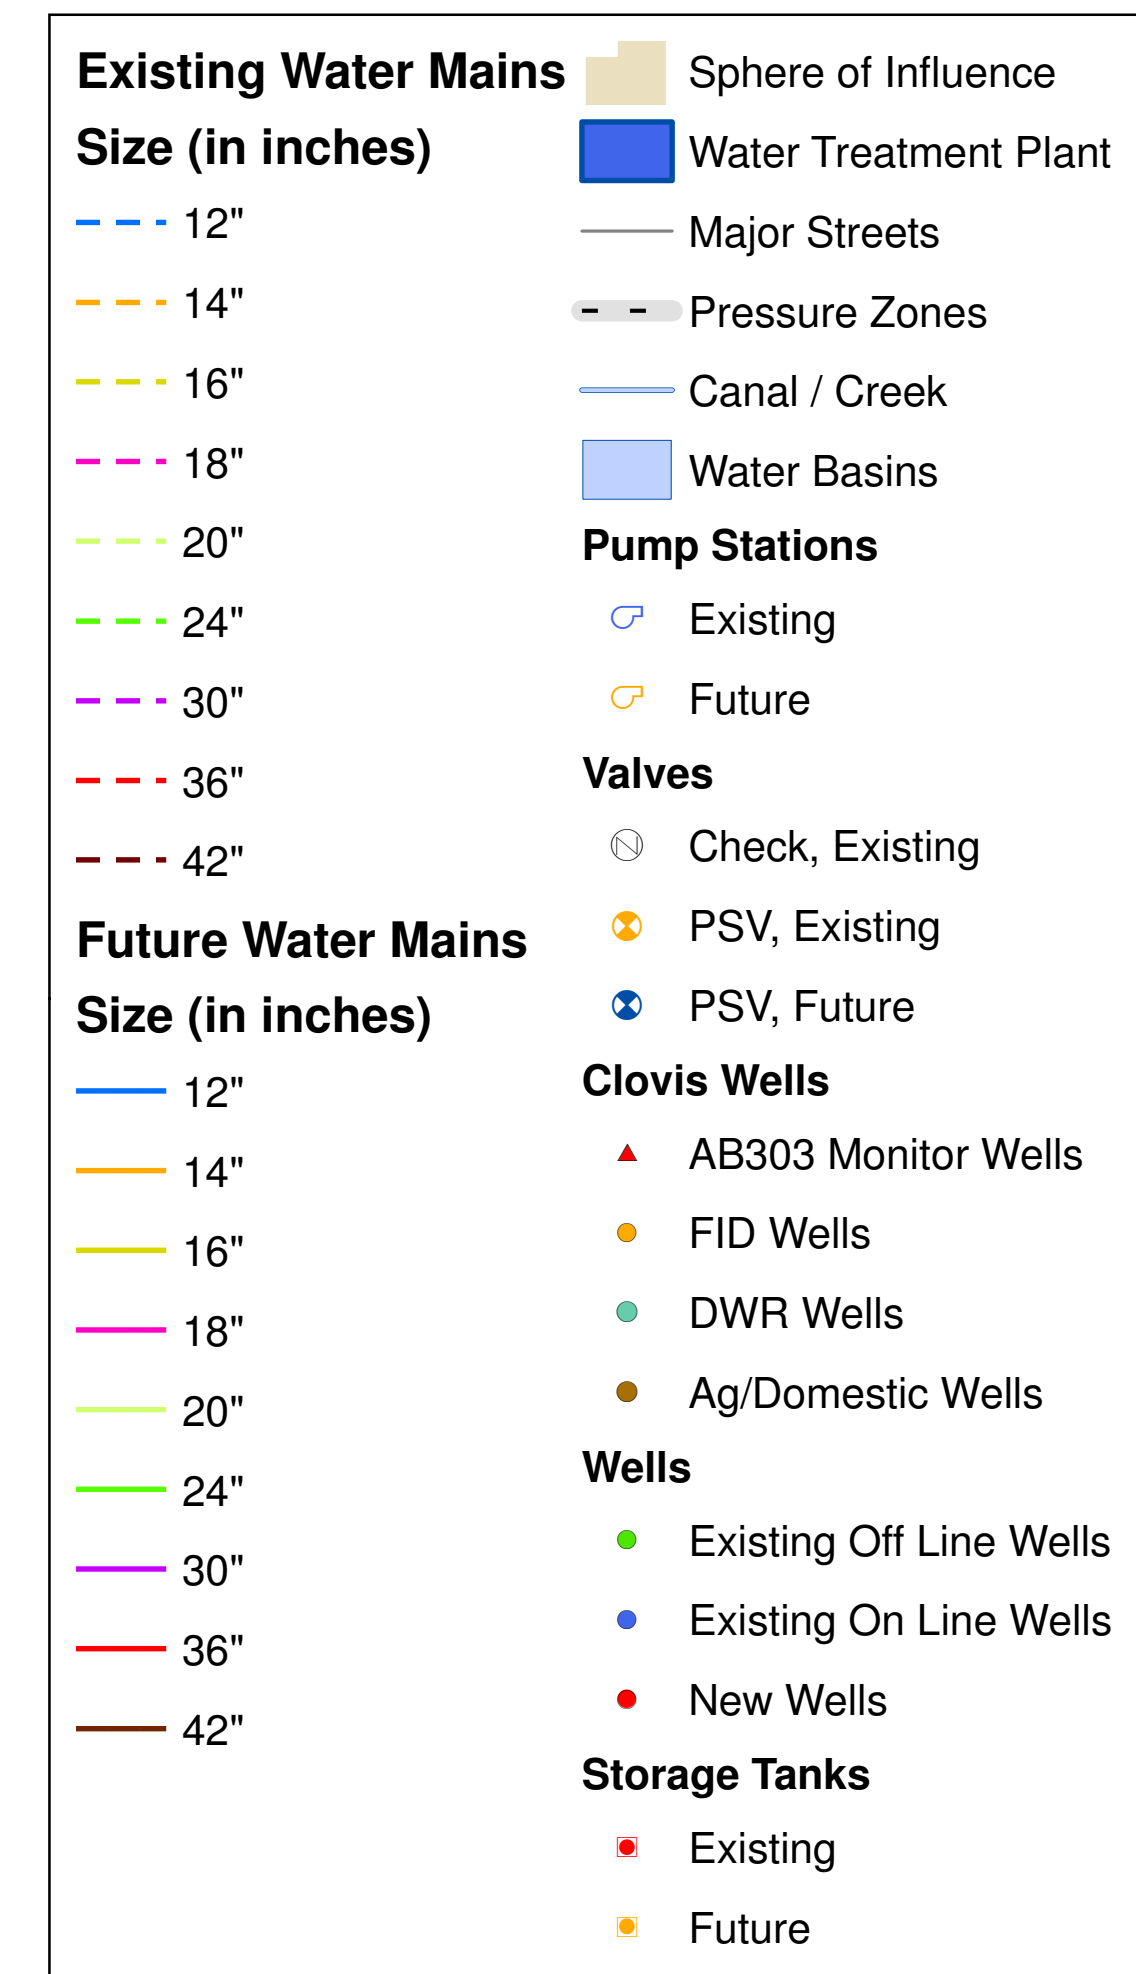

File: Basemap\_Facilities.mxd

EST. 1968

**PROVOST &  
PRITCHARD** INC

**ENGINEERING GROUP**

*An Employee Owned Company*